


General notes:

1. Subject to change through detailed design.
2. Cable dimensions and spacings to confirmed after detailed design.
3. Dimensions of cable depths to be confirmed after detailed design.
4. Bedding and cable cover surround to be confirmed after detailed design.
5. Dimensions in mm

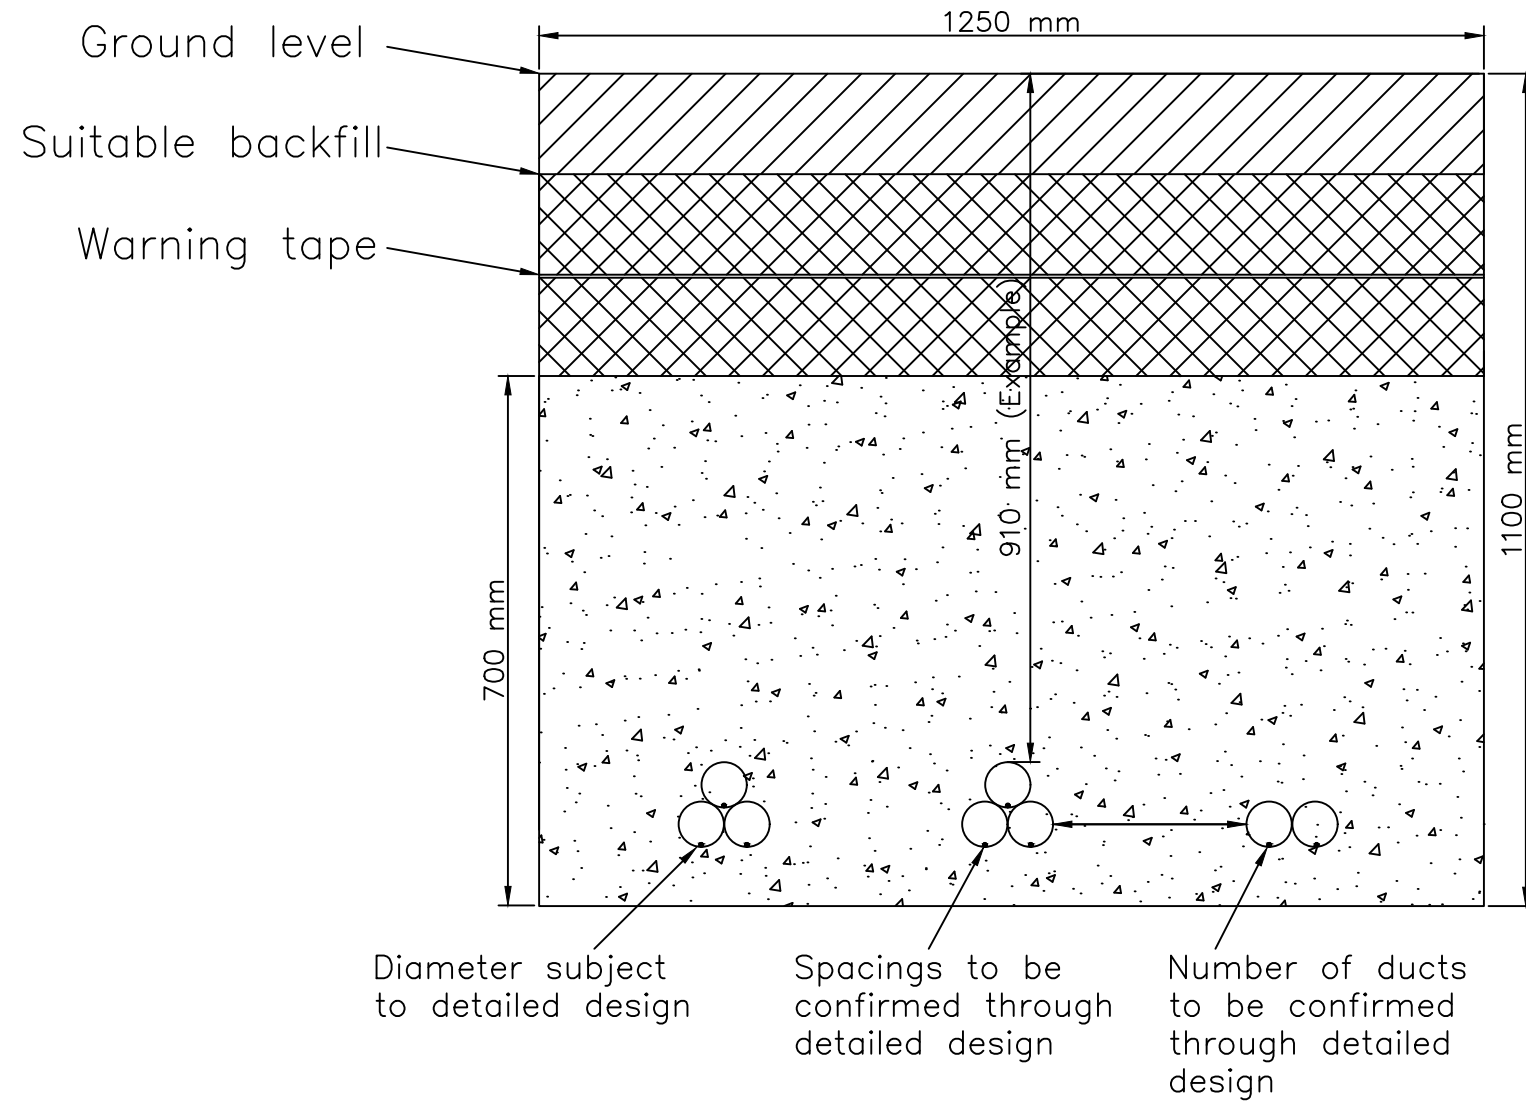

Scale: not to scale @ A3

Produced By: RB

Version: 0

Checked By: DF

Date: 03/05/2024

Surface Type	Voltage		
	33kV	11kV	Low Voltage
	Minimum Depth of cover (mm)		
Unmade ground, footways and footpaths	775	600	450
Roads	775	700	600
Cultivated grounds	775	700	600
Agricultural land	910	910	910

Figure 3.7

Indicative Cable Trench Detail

Oliver Forest Wind Farm

Environmental Impact Assessment Report